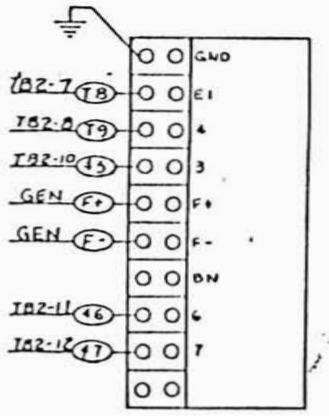

GVR
GENERATOR
VOLTAGE
REGULATOR
XRZ004

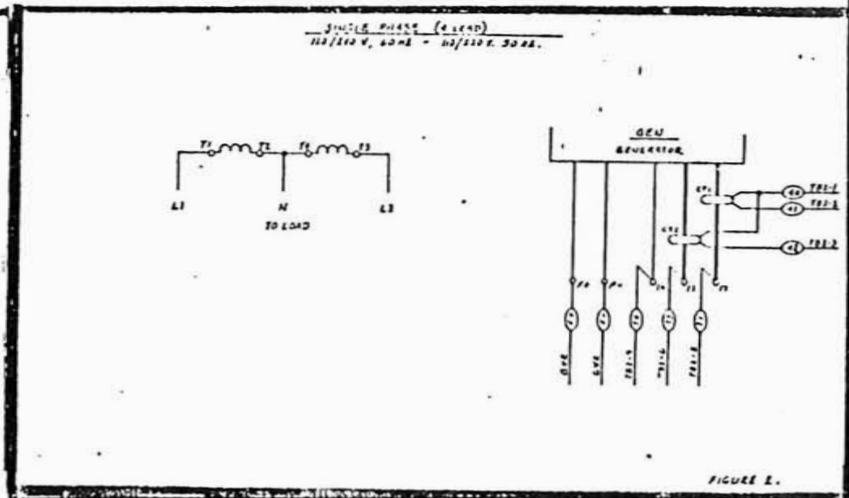

FIGURE 2.

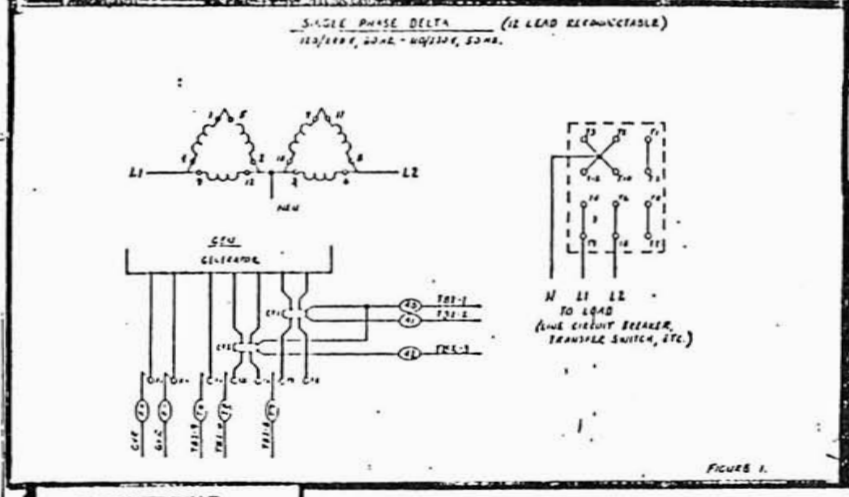

FIGURE 1.

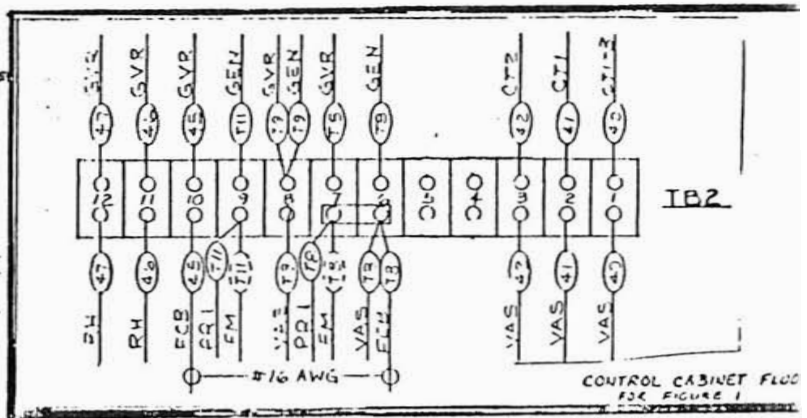

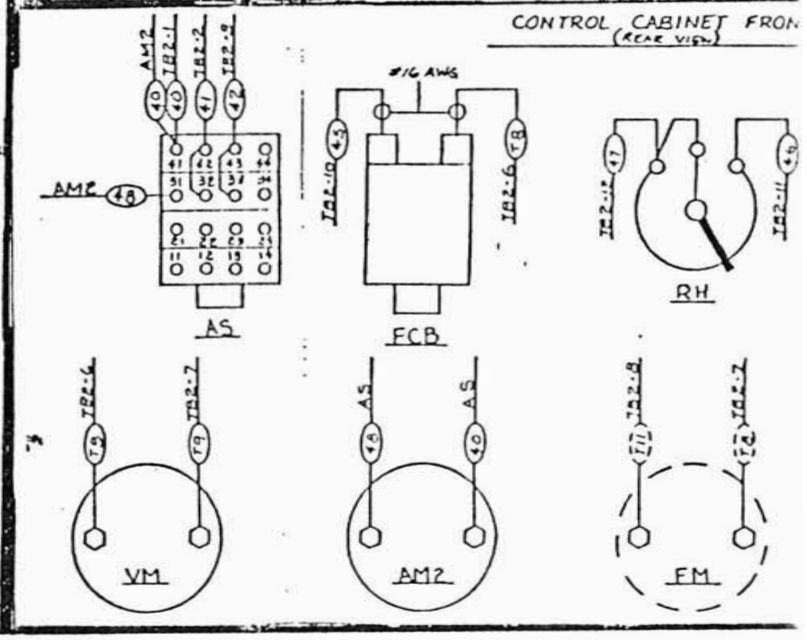

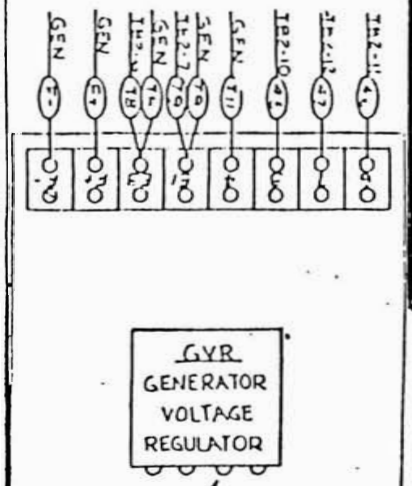

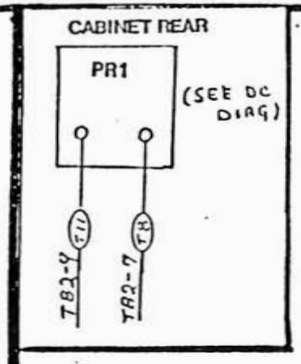

NOTES:
1) ALL INTERNAL CONTROL CABINET WIRES TO BE #20GA, EXCEPT AS NOTED
2) ALL INTERCONNECTING WIRES BETWEEN TB2& GEN-SET TO BE 16GA
3) USE GVR SENSING TRANSFORMER TAP FOR 208-240V
4) LOAD LEADS MAY BE FACTORY CONNECTED TO ACCESSORY ITEMS (CIRCUIT BREAKER,ETC)