


92439-1

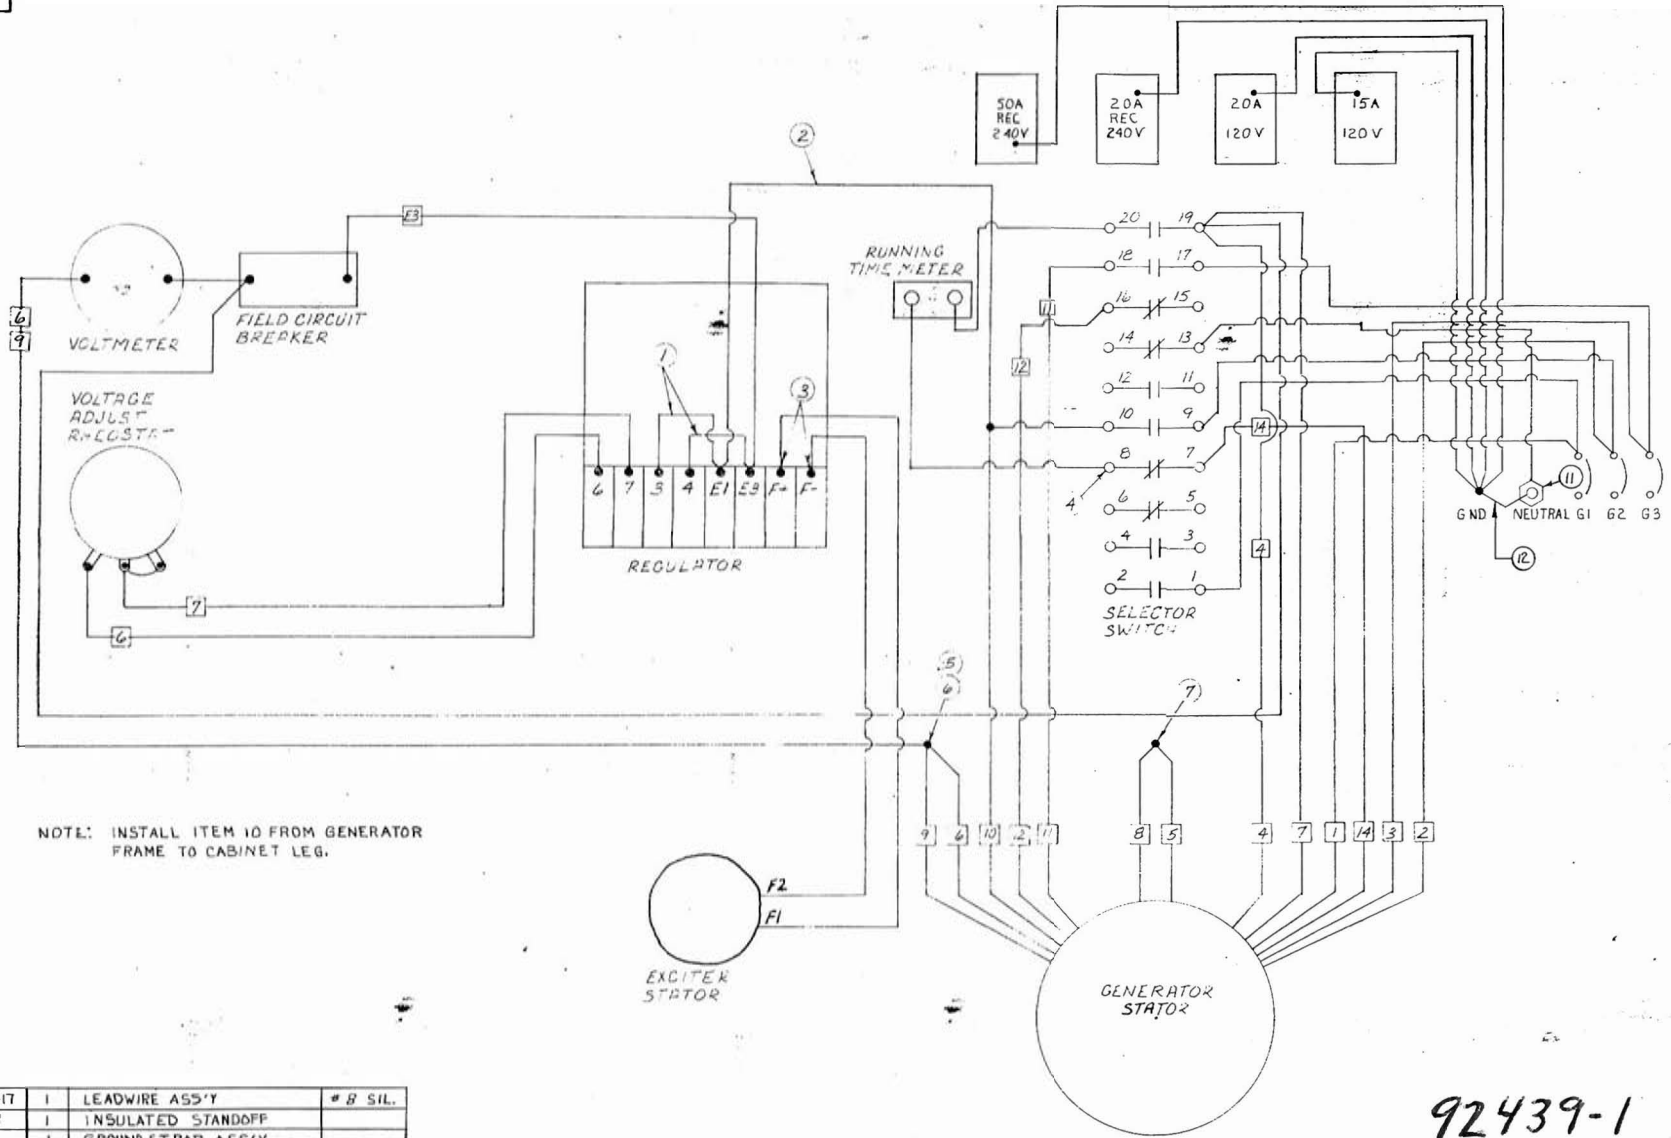

NOTE: INSTALL ITEM 10 FROM GENERATOR FRAME TO CABINET LEG.

92439-1

12	B-91848-17	1	LEADWIRE ASS'Y	# 8 SIL.
11	94-378	1	INSULATED STANDOFF	
10	A-95231	1	GROUND STRAP ASS'Y	
9	43674	1	LUG	
8	49975	BY 8920	CABLE TIE	
7	A-91494	1	CONNECTOR	
6	A-51320	1	INSULATION SLEEVE	
5	A-51319	1	CONNECTOR	
4	91437-1	9	LUG	
3	7777	2	LUG	
2	B-52150-134	1	LEADWIRE ASSEM.	
1	B-52150-31	2	LEADWIRE ASSEM.	

ALL DIMENSIONS GIVEN IN INCHES—NONE TO DIMENSIONS—DO NOT SCALE—GENERATOR MUST BE APPROVED BY DYMA TECHNOLOGY ENGINEERING DEPT BEFORE PROCEEDING WITH PRODUCTION — TOLERANCES (UNLESS OTHERWISE SPECIFIED): FRACTIONS ± 1/64 DECIMALS ± .005 PUNCHED HOLES ± .004 — .000						
DRAWN BY	DATE	CHEK BY	DATE	APPR'D BY	DATE	SCALE
D.M.W.	2-22-84	RH		RH	6-25-84	
MATERIAL: _____ PART NO: _____ REV: 092416 QUANTITY: 25000						
ORIGINAL				WIRING DIAGRAM TERMINATION ASSEMBLY		
DIVISION OF DYMA TECHNOLOGY, INC. LaCrosse, MN 56007						